

¹Gagandeep KAUR, ²Sunaina SAINI

DISTRIBUTED GENERATION PLACEMENT IN DISTRIBUTION NETWORK USING SELECTIVE PARTICLE SWARM OPTIMIZATION

¹⁻² Department of Electrical Engineering, I.K. Gujral Punjab Technical University, Punjab, INDIA

Abstract: The lack of synchronization of power supply and demand in distribution network leads to poor voltage profile on lines and increase of real power loss. The integration of Distribution Generation (DG) unit in these networks offers consistent supply of electrical power which accordingly recovers system voltage profile and consequently reduces real power losses. Placement of DG units at optimized location with optimal DG rating participate a vital role in distribution network to synchronize power supply and demand. This study demonstrates the identification of optimized DG placement and optimal DG rating through optimization techniques which were accomplished in MATLAB'13. In minimization of multi-objective function, the technical hitches were resolved using weight factor within the operating limits of network. Three techniques were accomplished on IEEE 33-bus and IEEE 69-bus standard distribution networks. Among these implemented techniques, Selective Particle Swarm Optimization (SPSO) has given the best result thereby minimizing the real power loss up to 48.09% for standard IEEE 33-bus system and 63.02% for IEEE 69-bus system.

Keywords: voltage profile, real power loss, distributed generation (DG), SPSO, distribution network

INTRODUCTION

In most of the developing countries, the centralized placed power plants supply to a multifaceted interconnected transmission and distribution networks. These networks are to transfer the power over long or short distances with an efficient manner at customer end [1]. In recent times a revolution of deregulation and restructured environment in centralized power system has confronted a challenge for power generating units to work independently and to meet the increasing power demand. This becomes a favorable opening to the dispersed generations such as distributed generators (DG) to present sufficient and dependable power release. Modernization of power system is enhancing the access of generated electricity & storage of power at distribution end. For consistent supply of power, placement of DG and demand organization is vital features as in [2]. For management of ever increasing challenge the most important deciding factor is the penetration level of DG units [3]. Several researchers have presented and examined the DG placement and DG rating problems by applying different optimization techniques. The instant variation in demand and probably higher demand and less supply leads to worsening of voltage profile or black outs in electric system networks. In year 1997, S/Se Brazil felt a major blackout due to voltage instability in power distribution network [4]. Hence, DG placement and DG rating in distribution network needs the must consideration of voltage profile constraints. Real power losses have major impact on the power quality, power transfer expenses and profits of electric companies. To improve power quality and reduce technical or non-technical losses, placement of DG units in distribution network has been approached as an attractive power source [5]. An optimization technique of Optimal Coordinated Voltage

Control (OCVC) has been implemented to investigate multi-objective problem to lessen voltage inaccuracies at DGs and pilot buses and reactive power deviations [6]. For improving voltage stability in distribution network, a multi objective performance index (MOPI) under several operating limits through Chaotic Artificial Bee Colony (CABC) has been introduced in [7]. For voltage profile increment and reduction of power losses through DG placement, Basu et.al has applied other methods such as fuzzy approach and Harmonic Search Algorithm (HSA) [8]. A simple fast load flow method has been applied for achievement of real power losses and voltage profile as in [9]. Here, with the installation of DG units of range of sizes at different site has been performed with backward forward sweep algorithm (BFSA). A researcher revealed a technique to offer solution through selection of candidate buses for DG location and rating. In this technique, prioritization of those candidate buses was done which were susceptible to voltage level and consequently, voltage stability margin were enhanced [10]. Placement of DG units on priority basis for power compensation in power deficiency period has been handled by continuous load flow and nodal analysis techniques [11]. Analysis of system performance on the basis of power reliability has been done with network reconfiguration in the continuation of DG units. Optimal DG placement has been identified with sensitivity analysis as in [12].

PROBLEM FORMULATION

— Power Loss Reduction Index

To lessen the power loss in distribution network system, power loss reduction index (PLRI), has been introduced and utilized to investigate the minimization of power loss in distribution network. The representation of PLRI is as below:

$$PLRI = \frac{PL(WDG)}{PL(WODG)} \quad (1)$$

where, PL (WDG) is loss of power while placing DG and PL (WODG) is loss of power when no DG in network.

— Voltage Profile Improvement Index

Voltage Profile is a primary feature of consideration while analyzing about power quality and power transfer in power distribution system. Voltage collapse sensitive buses are observed and DG is selected arbitrarily. Voltage profile improvement index (VPII) is another index to observe system voltage for continuity of power supply. VPII is represented as below:

$$VPII = \frac{VP(WDG)}{VP(WODG)} \quad (2)$$

Where, VP (WDG) & VP (WODG) are voltage profile with DG and without DG respectively.

— Objective Function for DG Integration

For integration of DG unit in power distribution system, several objective functions have been utilized by researchers to recover power quality of network. Here, grouping of two independent indexes i.e PLRI and VPII to minimize the multi-objective function defined below:

$$F = \text{minimization}(w_1 \times f_1 + w_2 \times f_2) \quad (3)$$

The function $f_1 = PLRI$ and function $f_2 = 1/VPII$,

To simplify the calculation and to decide the importance of primary parameter in multi-objective function, weights w_1 and w_2 are used. Here the weights have a sum in range of 0-1, and equal weight of 0.5 has been taken. Thus the objective function 'F' has been formed to achieve the optimal solution. The optimal DG rating and DG placement at optimal location has been obtained only on that candidate bus, where overall distribution network power loss is less.

OPTIMIZATION TECHNIQUES

— Repeated Load Flow

For repeated load flow (RLF) a standard procedure has been followed for integration of optimum DG rating in distribution system [13]. Load flow analysis has been done iteratively using forward backward method until optimum results has come out. First of all DG ratings has been defined and load flow for each candidate bus was made to flow. For the defined DG ratings, a power loss for every participating bus has been reported. The bus location having minimum power loss was the optimum DG placement and the equivalent DG rating size was the optimum size.

— Particle Swarm Optimization (PSO)

A stochastic search evolution computational procedure is again a popular population based and named Particle Swarm Optimization (PSO). Kennedy and Eberhart developed this technique by critically analyzing the activities of group of fishes and flock of birds. In PSO algorithm, a number of particles in population presents in search space having n-dimensions and shift from their location as per information w.r.t time. On the basis of this enough information, particle modifies its direction and shift on the way to best position called *pbest*. The overall best position based on shift of neighboring particles is called as *gbest*. The updating of

position by particle is according to best position faced by them and their neighbors [14].

In n-dimensional search space, the particle position as:

$$Zm = (zm_1, zm_2, \dots, zm_n) \quad (4)$$

Based on it, the current position of particle as:

$$Sk_{iD+1} = (Sk_{iD}) + (Sk_{iD+1}) \quad (5)$$

$i = 1, 2, \dots, n$ and $D = 1, 2, \dots, m$

where, Sk is the present particle position and $(Sk+1)$ the new position. The particle velocity in n-dimensional search space is:

$$Vm = (vm_1, vm_2, \dots, vm_n) \quad (6)$$

The updated velocity of particle is shown below:

$$vk_{iD+1} = wi \times viDk + c_1 \times rand \times (pbest_{iD} - Sk_{iD}) + c_2 \times rand \times (gbest_{iD} - Sk_{iD}) \quad (7)$$

where $vk+1$ = updated velocity, vk = present velocity, $pbest$ = individual best velocity, $gbest$ = overall best velocity, n = particles number in a population, m = participants number in a particle, $rand$ = random values generated, c = acceleration coefficient of particle, wi = inertia weight for each particle

The inertia weight is given by the equation:

$$w = \frac{w(\max) - w(\min)}{k(\max)} \times k$$

where, $wmax$ = maximum inertia weights, $wmin$ = minimum inertia weights, k = current inertia weight, kma = iterations count (max)

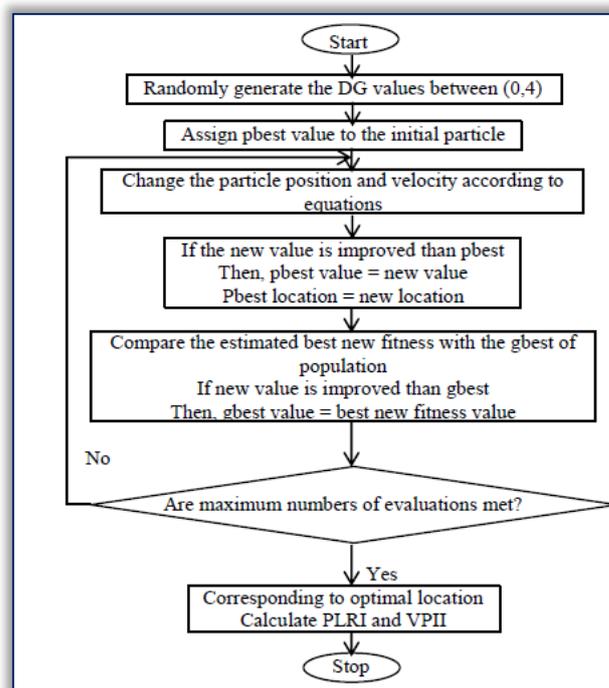


Figure 1. PSO Algorithm

The range random lies between 1 & 2 and suitable value for c_1 and c_2 is 2. The selection of $wmax$ and $wmin$ values is by hit and trial method [15]. Figure 1 depicts the flow chart for optimal placement of DG and DG rating size in distribution system through PSO. DG rating or size has been limited (0, 4) when PSO techniques was applied in MATLAB. The DG values were selected as particles to be optimized to minimize the value of objective function.

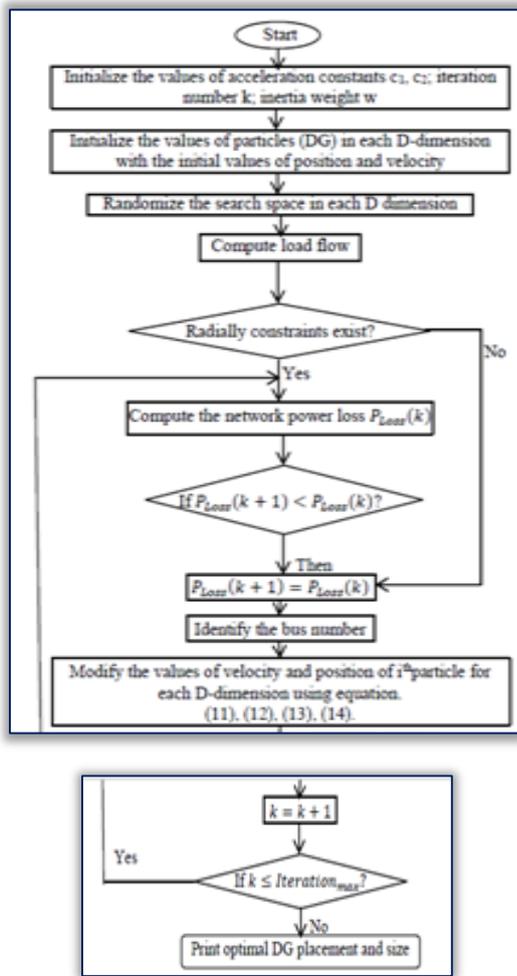


Figure 2. SPSO Algorithm

— Selective Particle Swarm Optimization (SPSO)

In recent years, the improved versions of PSO technique have been proposed and used by researchers with objectives to increase usage of this technique with fast convergence speed and better optimal solutions. An advanced version of PSO is binary PSO (BPSO) through modulating search space to be binary. This technique has been developed by Kennedy and Eberhart and is a discrete version of PSO [16]. Again the advanced version of BPSO is SPSO, proposed by Khalil and Gorpnich [17], where solution quality is improved by adopting sigmoid transformation of velocity function for selection of search space. In SPSO technique, for search space a set of DN positions is $SD = [SD_1, SD_2, \dots, SD_N]$ for each D dimension, where DN are the selected positions in dimension D.

$$\begin{aligned}
 (v_{iDk+1}) &= DN \cdot 11 + \exp(-v_{iDk+1}) & (9) \\
 x_{iDk+1} &= \{SD_1 \text{ if } sig(v_{iDk+1}) < 1 \\
 & \quad SD_2 \text{ if } (v_{iDk+1}) < 2 \\
 & \quad SD_N \text{ if } (v_{iDk+1}) < N\} & (10)
 \end{aligned}$$

where, SD_1, SD_2, \dots, SD_N are the selected values for each particle in dimension D.

Velocity constraints $[Vmin, Vmax]$ can be calculated using the following equation:

$$\begin{aligned}
 v_{iDk+1} &= \{Vmax, \text{if } v_{iDk+1} > Vmax \\
 & \quad v_{iDk+1}, |v_{iDk+1}| \leq Vmax
 \end{aligned}$$

$$Vmin, iDk+1 < Vmin \dots (11)$$

$$\begin{aligned}
 v_{iDk+1} &= \{rand \times v_{iDk+1}, \text{if } |v_{iDk+1}| = |v_{iDk}| \\
 & \quad v_{iDk+1} \text{ otherwise}
 \end{aligned}$$

The invariability of i^{th} particle velocity value in a D-dimension at the minimum or maximum values can be ignored using the equation given below and push the particles going through the selected space.

To find out the solution for optimal DG placement and DG rating or size there would be key steps distribution system:

1. Indicate the number of dimensions
2. Identification of search space for all dimensions
3. To select an optimal solution from the search spaces by implementing SPSO

The buses of the network represent the search space of a specific dimension. For standard IEEE systems the candidate buses represents search space for a system dimension. The random selection of the DG size is for a particular bus of one dimension at a time. The SPSO after identification of search space of each dimension employs an optimal solution for enhancement of power quality.

RESULTS AND DISCUSSIONS

The optimization techniques implemented for this study has been largely analyzed on standard radial networks consist of IEEE 33 & IEEE 69 bus systems. Both the test systems have been gone through load flow, optimal DG placement and DG rating have been identified using above proposed optimization techniques with simultaneously minimizing the objective function. How the simultaneous optimal placement of DG and optimal DG rating improve the power quality in terms of loss reduction and enhanced voltage profile have been compared and discussed in both test systems.

— IEEE -33 Test System

To minimize the objective function in IEEE 33 test system, the two main parameters of concern i.e reduction of power loss and improved voltage profile have been analyzed. For the system base voltage taken was 12.6 KV, the power losses (real & reactive) before DG placement has been found 210 KW and 143.0 KVAR respectively.

Table 1: Outcome after DG Integration

IEEE 33- Bus System	RLF	PSO	SPSO
Real Power Loss (KW)	111.02	111.07	109
Minimum Voltage Profile	0.94251 Bus 18	0.94324 Bus 18	0.94900 Bus 18
Optimum DG Rating (MW) & Placement	2.6 Bus 6	2.6509 Bus 6	2.5173 Bus 6

The total apparent power loss was 254.065 for the base case. The minimum voltage profile was at bus-18 which was 0.90377 before DG placement in distribution network. With the implementation of these techniques bus having minimum real power loss has been identified. In correspondence of that, optimal DG rating, power loss and voltage profile were calculated. The outcome after DG integration is displayed in table 1 and voltage profile & power loss against these techniques is shown in figure 3 & 4 respectively. Indexes VPll and PLRI were also computed

which shows the impact of DG location by optimization with these techniques.

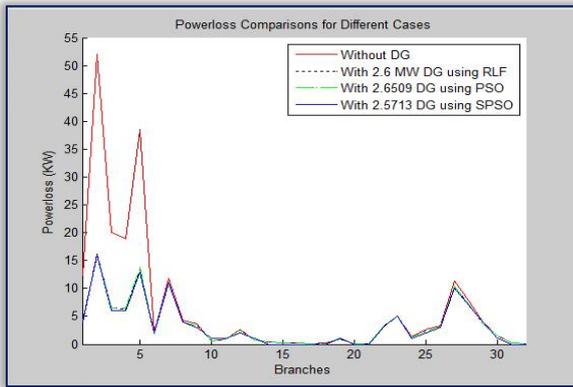


Figure 3. Voltage Profile Improvement

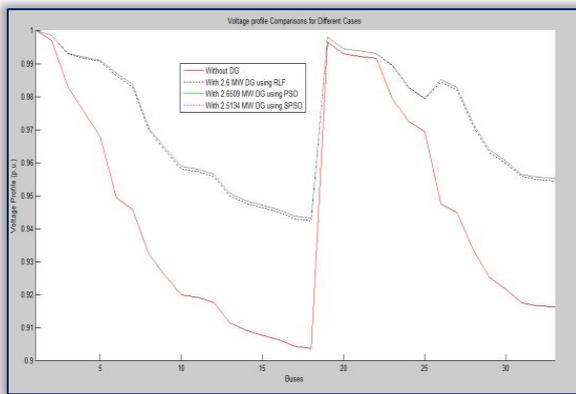


Figure 4. Power Loss Reduction

Figure 5 and Figure 6 illustrates about VPIL and PLRI with DG installation for RLF, PSO, and SPSO. After optimizing the indexes, the table-2 demonstrates the values of objective function "F", f_1 , & f_2 and function is minimized up to 0.5. The comparison of results of techniques revealed that PSO has better findings than RLF, but overall SPSO has given best results.

Table 2. Minimization of Objective Function

Objective Function	RLF	PSO	SPSO
f_1	1.0	1.0	1.0
f_2	0.31026	0.30584	0
F	0.65513	0.65292	0.5

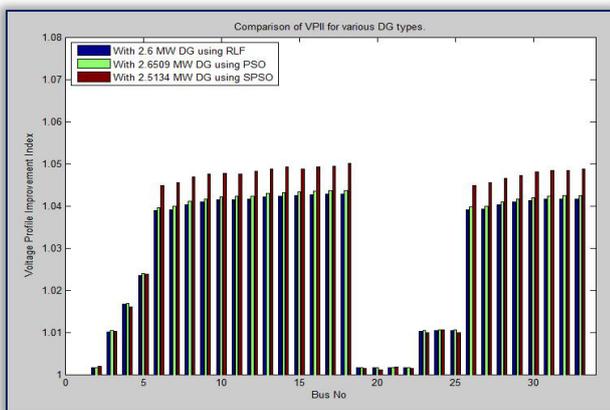


Figure 5. Comparison of VPIL

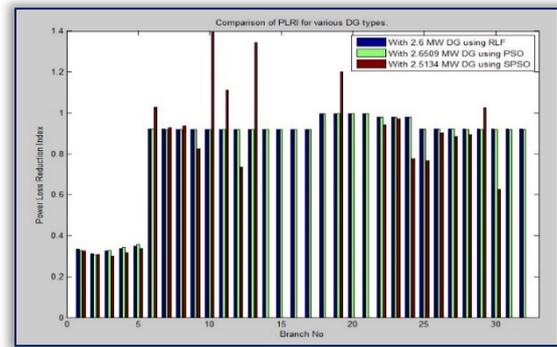


Figure 6. Comparison of PLRI

— IEEE-69 Test Systems

These optimization techniques have been implemented on IEEE-69 radial distribution network for minimization of objective function. The base case voltage value has been taken as 12.66 KV, apparent power loss of 247.36 KVA with the real and reactive power losses of 225 KW and 102.53 KVAR respectively before DG integration in distribution network.

Table-3 presents the results after DG integration in 69- bus distribution networks. Results present that minimum power loss is 83.02 KW by integrating 1.857 MW DG at bus number 61. Simultaneously voltage profile of 0.968 has also been improved while using SPSO, better than other cases. Figure 7 and figure 8 shows the comparison of voltage profile and power loss for all implemented techniques.

Table 3. Outcome after DG Integration

69- Radial Bus System	RLF	PSO	SPSO
Real Power Loss (KW)	84.065	84.117	83.20
Minimum Voltage Profile	0.96259 Bus 27	0.96253 Bus 27	0.968 Bus 27
Optimum DG Rating (MW) & Placement	1.8 Bus 61	1.79 Bus 61	1.857 Bus 61

The determination of VPIL and PLRI were also done for all approaches which presents change in voltage profile and power losses. Figure 9 and Figure 10 shows VPIL & PLRI for RLF, PSO, and SPSO techniques with DG placement. The multi-objective function has been minimized by using these three approaches. Table-4 displays the values for objective function F' for different cases and maximum minimization is up to 0.50021 with SPSO.

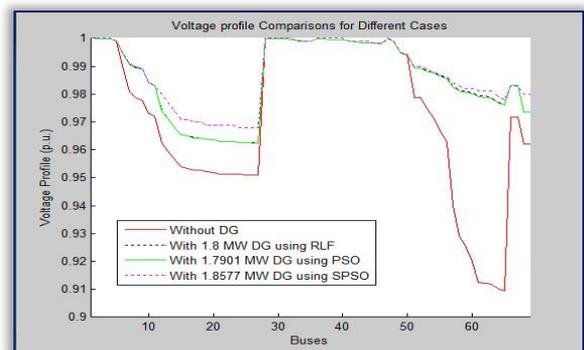


Figure 7. Comparing Voltage Profile

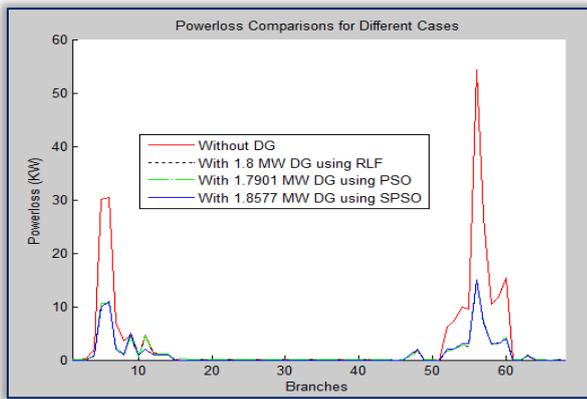


Figure 8. Comparing Power Loss

Table 4. Objective Function for IEEE 69-Test System

Objective Function Value	RLF	PSO	SPSO
f 1	1	1	1
f 2	0.27212	0.27201	0
F	0.63606	0.636	0.50021

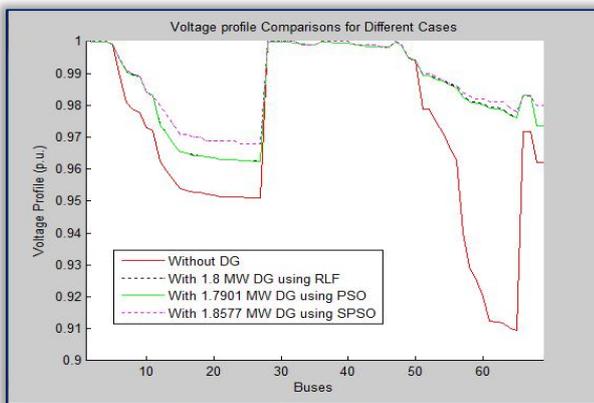


Figure 9. VPIL for RLF, PSO and SPSO

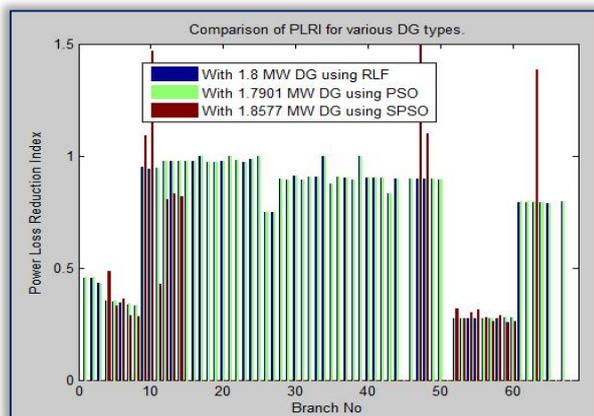


Figure 10. PLRI for RLF, PSO and SPSO

CONCLUSIONS

In this study, minimization of multi-objective function for two networks has been done which further calculates VPIL and PLRI indexes for better voltage profile and less power loss. For 33-bus network the reduction in real power loss was observed to be 47.13% for RLF, 47.10% for PSO and 48.09% in case of SPSO. On the other side for 69-bus system, 62.637 %, 62.614% and 63.02% of power loss has been reduced by RLF,

PSO and SPSO respectively. Voltage profile has been improved while placing DG unit. Study concludes that SPSO technique has given best results in both test systems.

References

- [1] S. Safigianni, G. N. Koutroumpetis, and V. C. Poulis, Mixed Distributed Generation Technologies in a Medium Voltage Network, *Electric power Systems Research*, vol. 96, pp. 75-80, 2013.
- [2] P. Chiradeja, Benefit of Distributed Generation: A Line Loss Reduction Analysis, *IEEE/PES Transmission and Distribution Conference & Exhibition: Asia and Pacific Dalian, China*, pp. 1-5, 2005.
- [3] Poornazaryan, P. Karimyan, G. B. Gharepetian, and M. Abedi, Optimal Allocation and Sizing of DG Units Considering Voltage Stability, Losses and Load Variations, *Electrical Power and Energy Systems*, vol. 79, pp.42-52, 2016.
- [4] R. B. Prada, and L. J. Souza, Voltage Stability and Thermal Limit: Constraints on the Maximum Loading of Electrical Energy Distribution Feeders, *Proceeding of Inst. Electr. Eng. - Gen. Trans. Distrib.*, vol. 145, pp. 573-577, 1998.
- [5] D. Q. Hung, N. Mithulanathan, R. C. Bansal, Analytical Expressions for DG Allocation in Primary Distribution Networks, *IEEE Trans Energy Conv.*, vol. 25, no. 3, pp. 814-820, 2010.
- [6] J. R. Castro, M. Saad, S. Lefebvre, D. Asber, and L. Lenoir, Optimal Voltage Control in Distribution Network in the Presence of DGs, *Electrical Power and Energy Systems*, vol.78, pp. 239-247, 2016.
- [7] N. Mohandas, R. Balamurugan and L. Lakshmi N., Optimal Location and Sizing of Real Power DG Units to Improve the Voltage Stability in the Distribution System using ABC Algorithm United with Chaos, *Electrical Power and Energy Systems*, vol.66, pp. 41-52, 2015.
- [8] P. S. Babu and R. M. Mohan, Optimal Performance Enhancement of DG for Loss Reduction using Fuzzy and Harmonic Search Algorithm, *IEEE International Conference on Electrical Electronics Signals, Communication & Optimization*, Jan 24-25, Vishakhapatnam, India, 2015.
- [9] E. K. Bindumol and C. A. Babu, A Simple and Fast Load Flow Algorithm for Sizing and Placement of DG in Radial Distribution System, *IEEE International Conference on Electrical Electronics Signals, Communication & Optimization*, Jan 24-25, Vishakhapatnam, India, 2015.
- [10] R. S. Al Abri, E. F. El-Saadany, and Y. M. Atwa, Optimal Placement and Sizing Method to Improve the Voltage Stability Margin in a Distribution System using Distributed Generation, *IEEE Tranaction on Power System*, Vol. 28, No.1, pp. 326- 334, Feb 2013. 2015.
- [11] M. Ettehad, H. Ghasemi, and S. Vaez-Zadeh, Voltage Stability-Based DG Placement in Distribution Networks, *Electrical Transaction on Power Delivery*, vol.28, No.1, pp. 171-178, Jan 2013.
- [12] R. S. Rao, K. Ravindra, K. Satish, and S. V. L.Narasimham, Power Loss Minimization in Distribution System using Network Reconfiguration in the presence of Distributed Generation, *IEEE Transaction on Power System*, vol.28, No.1, 2013.

- [13] N. Acharya, P. Mahat, and N. Mithulananthan, An Analytical Approach for DG Allocation in Primary Distribution Network, *Electrical Power and Energy Systems*, vol.28, pp. 669-678, 2006.
- [14] J. Kennedy and R. Eberhart, Particle Swarm Optimization, *Proceeding of IEEE International Conference on Neural Network (ICNN'95)*, vol. 5, pp. 1942-1948, Perth, Australia, Nov 29-Dec 1, 1995.
- [15] R. C. Eberhart , and Y. Shi, Comparing Inertial Weights and Constriction Factor in Particle Swarm Optimization, *Proceeding of International Congress on Evaluating Computation*, pp. 84-88, San Diego California, Piscataway, NJ: IEEE Service Center, 2000.
- [16] J. Kennedy and R. Eberhart, A Discrete Binary Version of the Particle Swarm Algorithm, *IEEE International Conference on Systems, Man and Cybernetics(SMC 97)*, Vol.5, pp. 4104-4108, 1997.
- [17] T. M. Khalil and A.V. Gorpinich, Optimal Conductor Selection and Capacitor Placement for Loss Reduction of Radial Distribution Systems by Selective Particle Swarm Optimization, *IEEE Seventh International Conference on Computer Science & Systems*, Nov. 27-29, Cairo, Egypt, pp. 215-220, 2012.



ISSN: 2067-3809

copyright © University POLITEHNICA Timisoara,
Faculty of Engineering Hunedoara,
5, Revolutiei, 331128, Hunedoara, ROMANIA
<http://acta.fih.upt.ro>